



**IMPORTANT:**  
COMPRESSOR EQUIPPED WITH AN EXTERNAL OF INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.  
USE COPPER CONDUCTORS ONLY.  
(EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.)

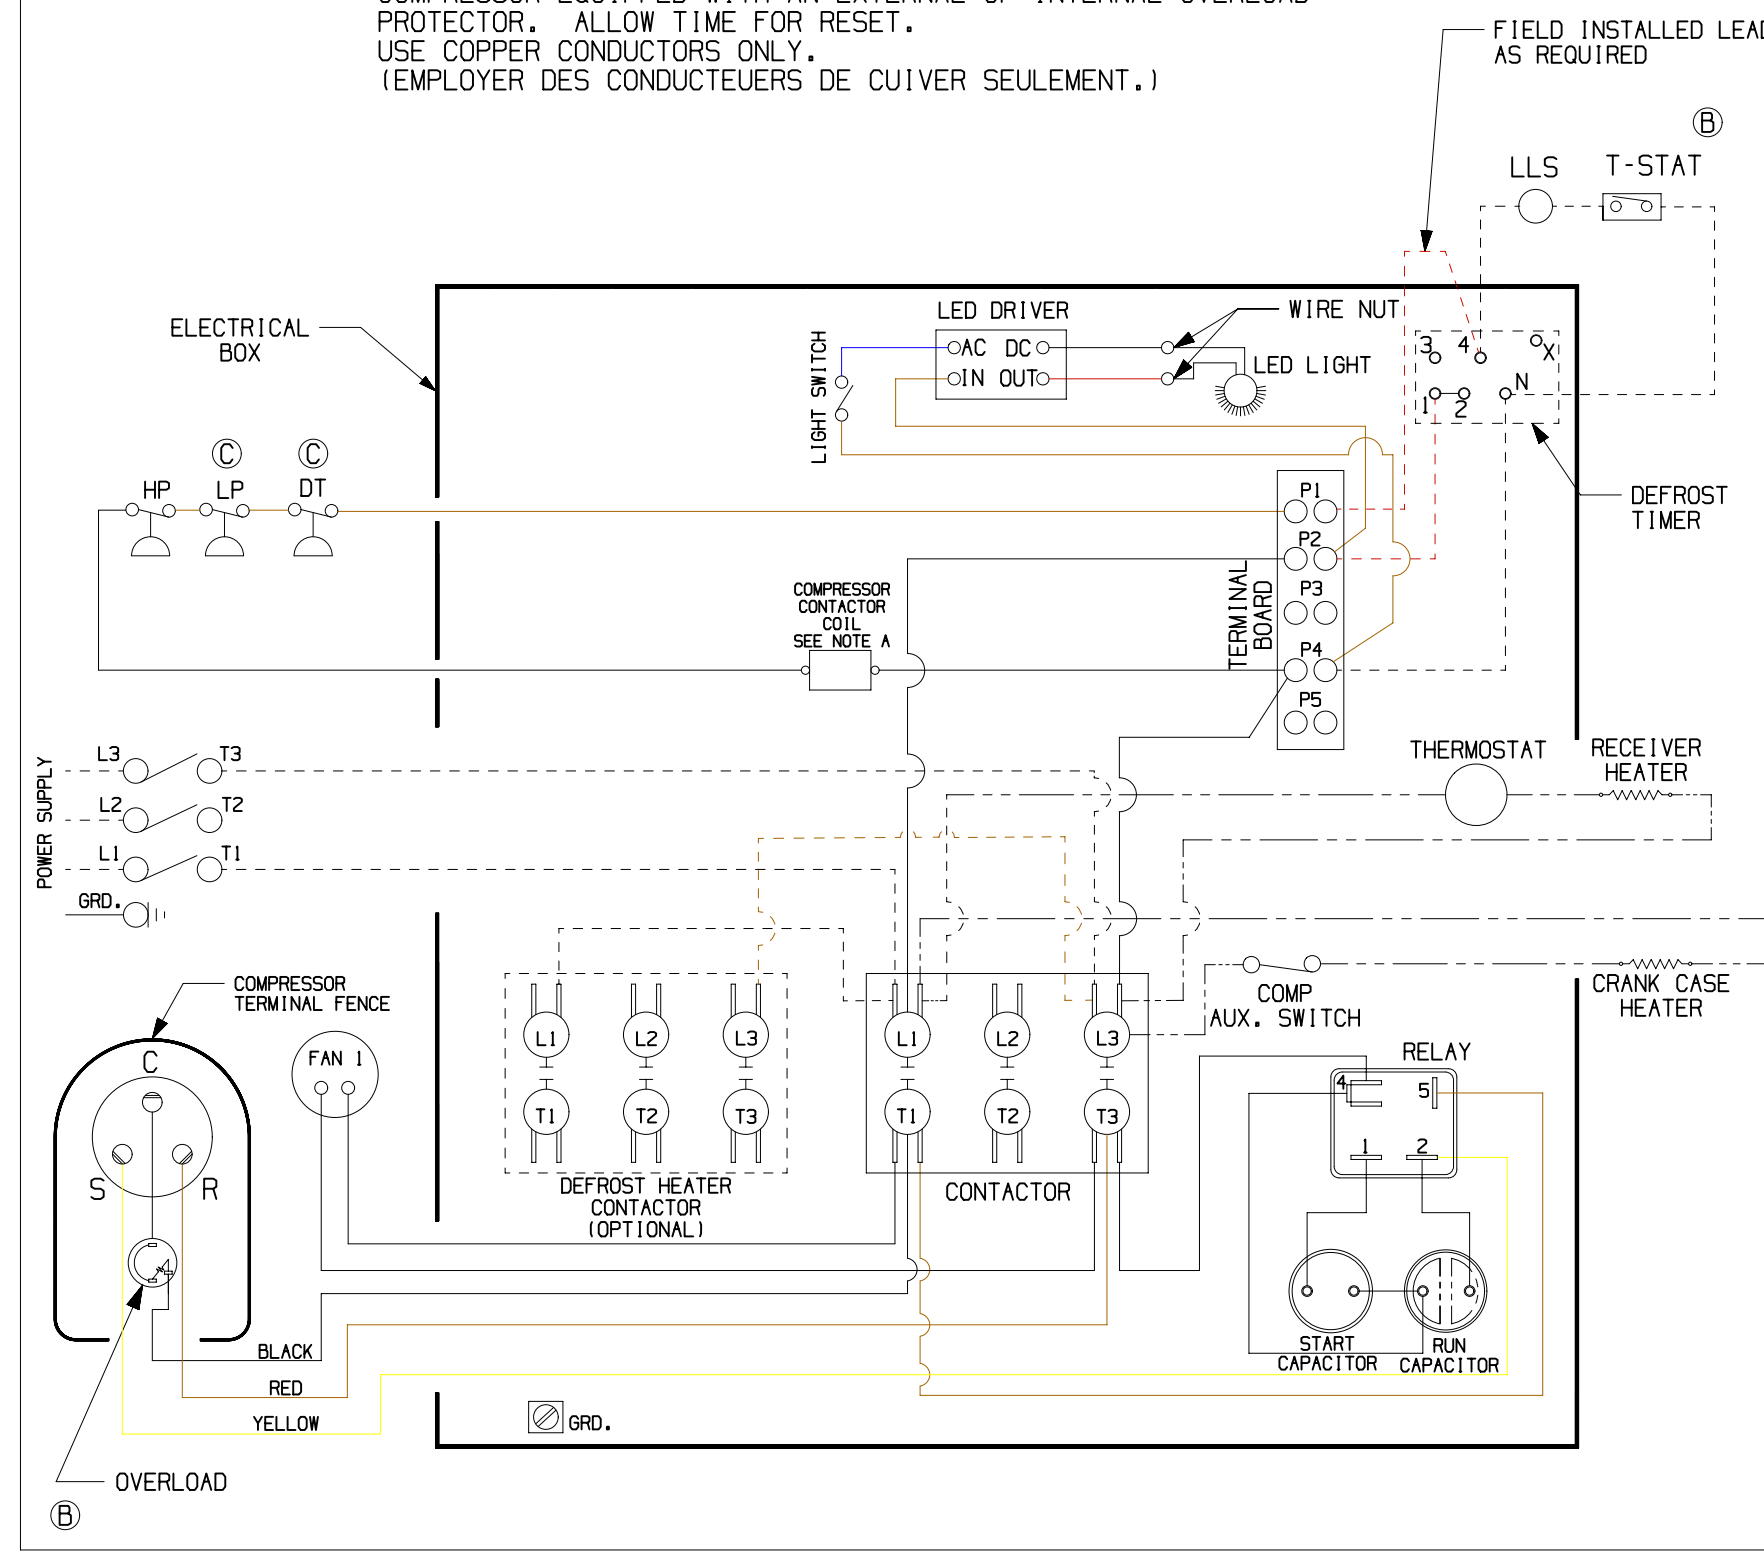

**NOTES**

- FIELD WIRING NOTES**
1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
  2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COPPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING.
  3. PLACE JUMPER ACROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
  4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
  5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
  6. IF DEFROST TIMER, LLS & T\*STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

- GENERAL NOTES:**
- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED IN PANEL AS SHOWN.
  - B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION.
  - C. COMPRESSOR EQUIPPED WITH AN EXTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

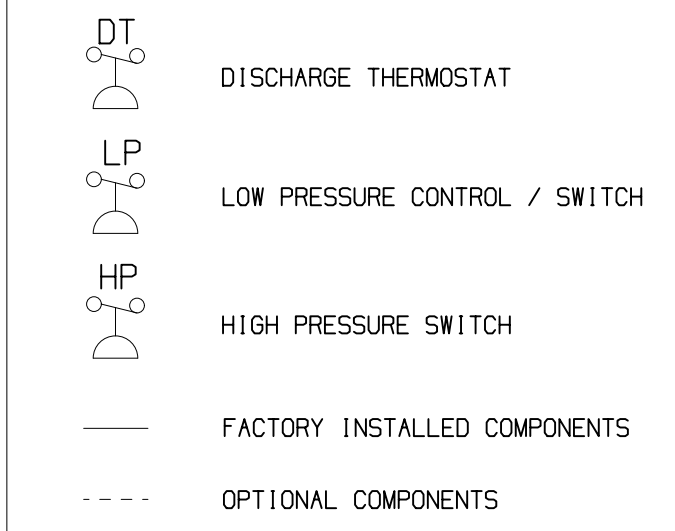

CONDENSING UNIT WIRING

REVISION	12JUL23	PART NO.	91300
----------	---------	----------	-------

- NOTES:**
1. REDUCE WHEN PRINTING WITH BORDER LINE OF APPROX. 7.75 x 10.75
  2. MATERIAL: Z-ULTIMATE 3000 WHITE.
  3. PRINTING TO BE IN COLOR WITH HEAVY ENOUGH PEN WEIGHT AND UL APPROVED INK.
  - ▲ 4. MUST COMPLY WITH T.P.Co. GLOBAL SPEC 08.
  - ⓑ 5. SEE SHEET 2 FOR PRODUCTION PRINTABLE VERSION.

3D,VNX10

ENGLISH

Q.A. SYMBOLS

- ★ = CATEGORY I
- ▲ = CATEGORY II
- = CATEGORY III
- = CATEGORY IV

REV	LT	LC	CHANGE	DATE
C	5C	EC109884	UPDATED WIRING DIAGRAM	51MRAN 12JUL23
B	3D 5D 6A	EC101457	UPDATED WIRING DIAGRAM	TS 23JUN21
A	--	EC90957	WIRING DIAGRAM SIZE UPDATED	KS 13JUN19
REL		EC90083		----

THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY. (TECUMSEH) AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION. ANY REPRODUCTION OR DISSEMINATION OF THIS INFORMATION WITHOUT THE EXPRESS AND WRITTEN CONSENT OF TECUMSEH AND THAT SUCH INFORMATION ONLY AS EXPRESSLY AND SPECIFICALLY APPROVED IN WRITING BY TECUMSEH SHALL BE COPIED OR REPRODUCED IN ANY MANNER OR TO ANY EXTENT WITHOUT TECUMSEH'S PRIOR EXPRESS AND SPECIFIC WRITTEN CONSENT AND (1V) SHALL BE RETURNED BY THE RECIPIENT TO TECUMSEH AT THE REQUEST OF THE RECIPIENT'S REQUEST PROMPTLY AFTER SUCH REQUEST IS MADE.

DIS.CODE --

NAME **WIRING DIAGRAM STICKER**

SCALE 1:1 & NOTED

THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO


**TECUMSEH PRODUCTS CO.**  
ANN ARBOR, MICHIGAN

MATERIAL NOTED

DRAWING NO. 91300

**(B) IMPORTANT:**

COMPRESSOR EQUIPPED WITH AN EXTERNAL OF INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.  
 USE COPPER CONDUCTORS ONLY.  
 (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.)

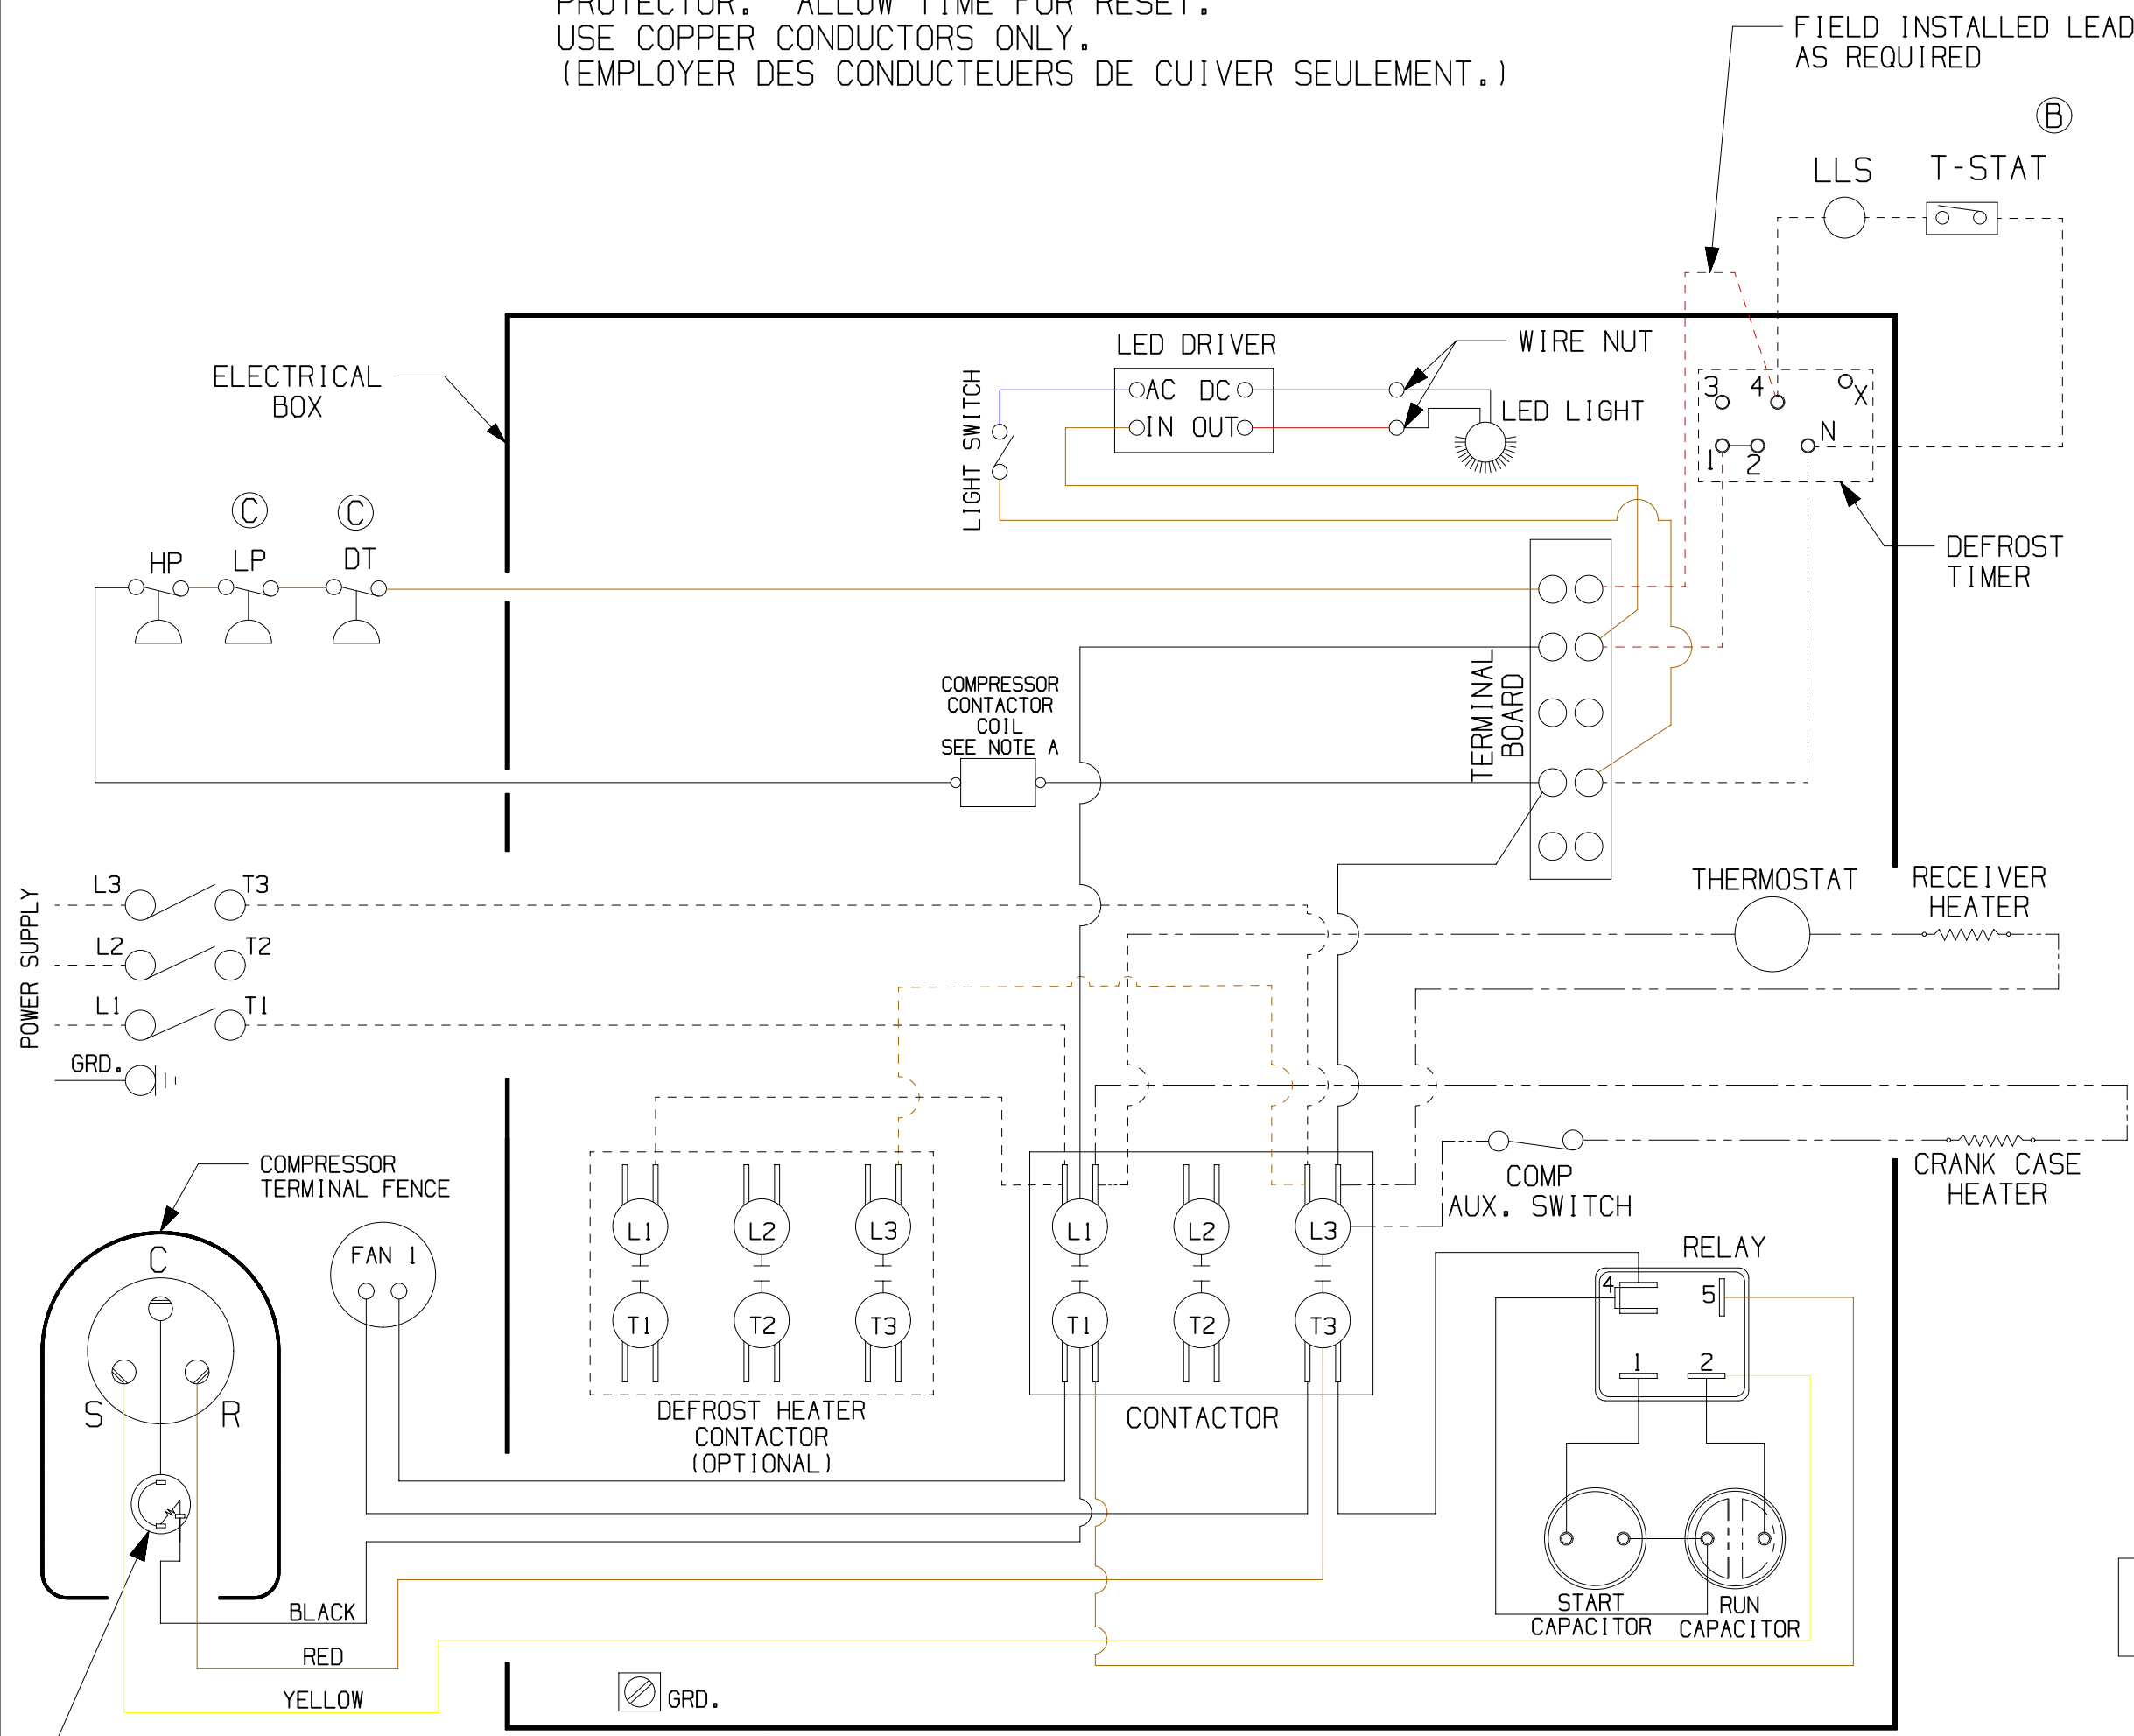


NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COPPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING
3. PLACE JUMPER ACCROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T\*STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:

- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED IN PANEL AS SHOWN.
- B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION.
- C. COMPRESSOR EQUIPPED WITH AN EXTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

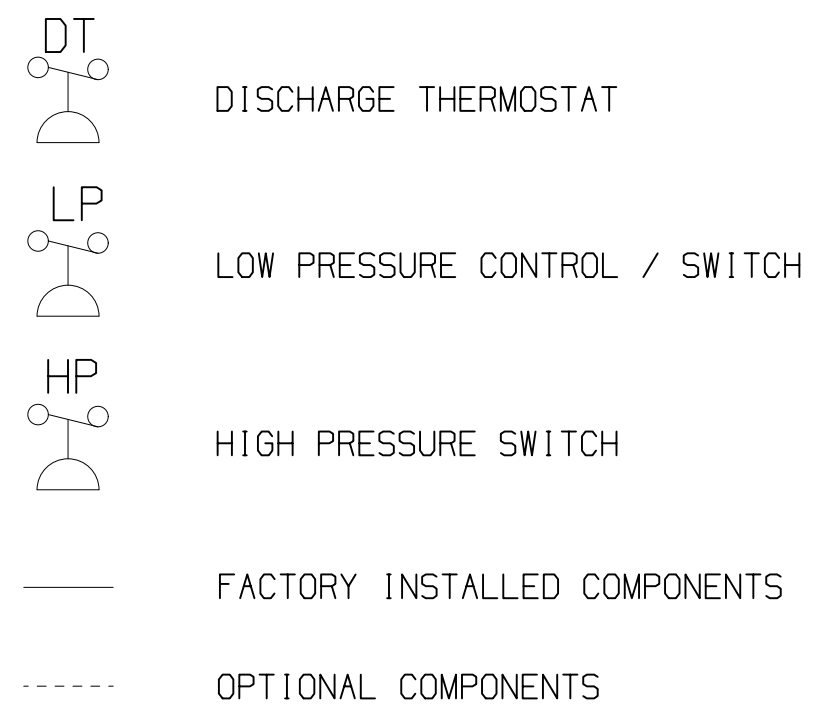

CONDENSING UNIT WIRING



C	12JUL23	PART NO.
REVISION		91300