


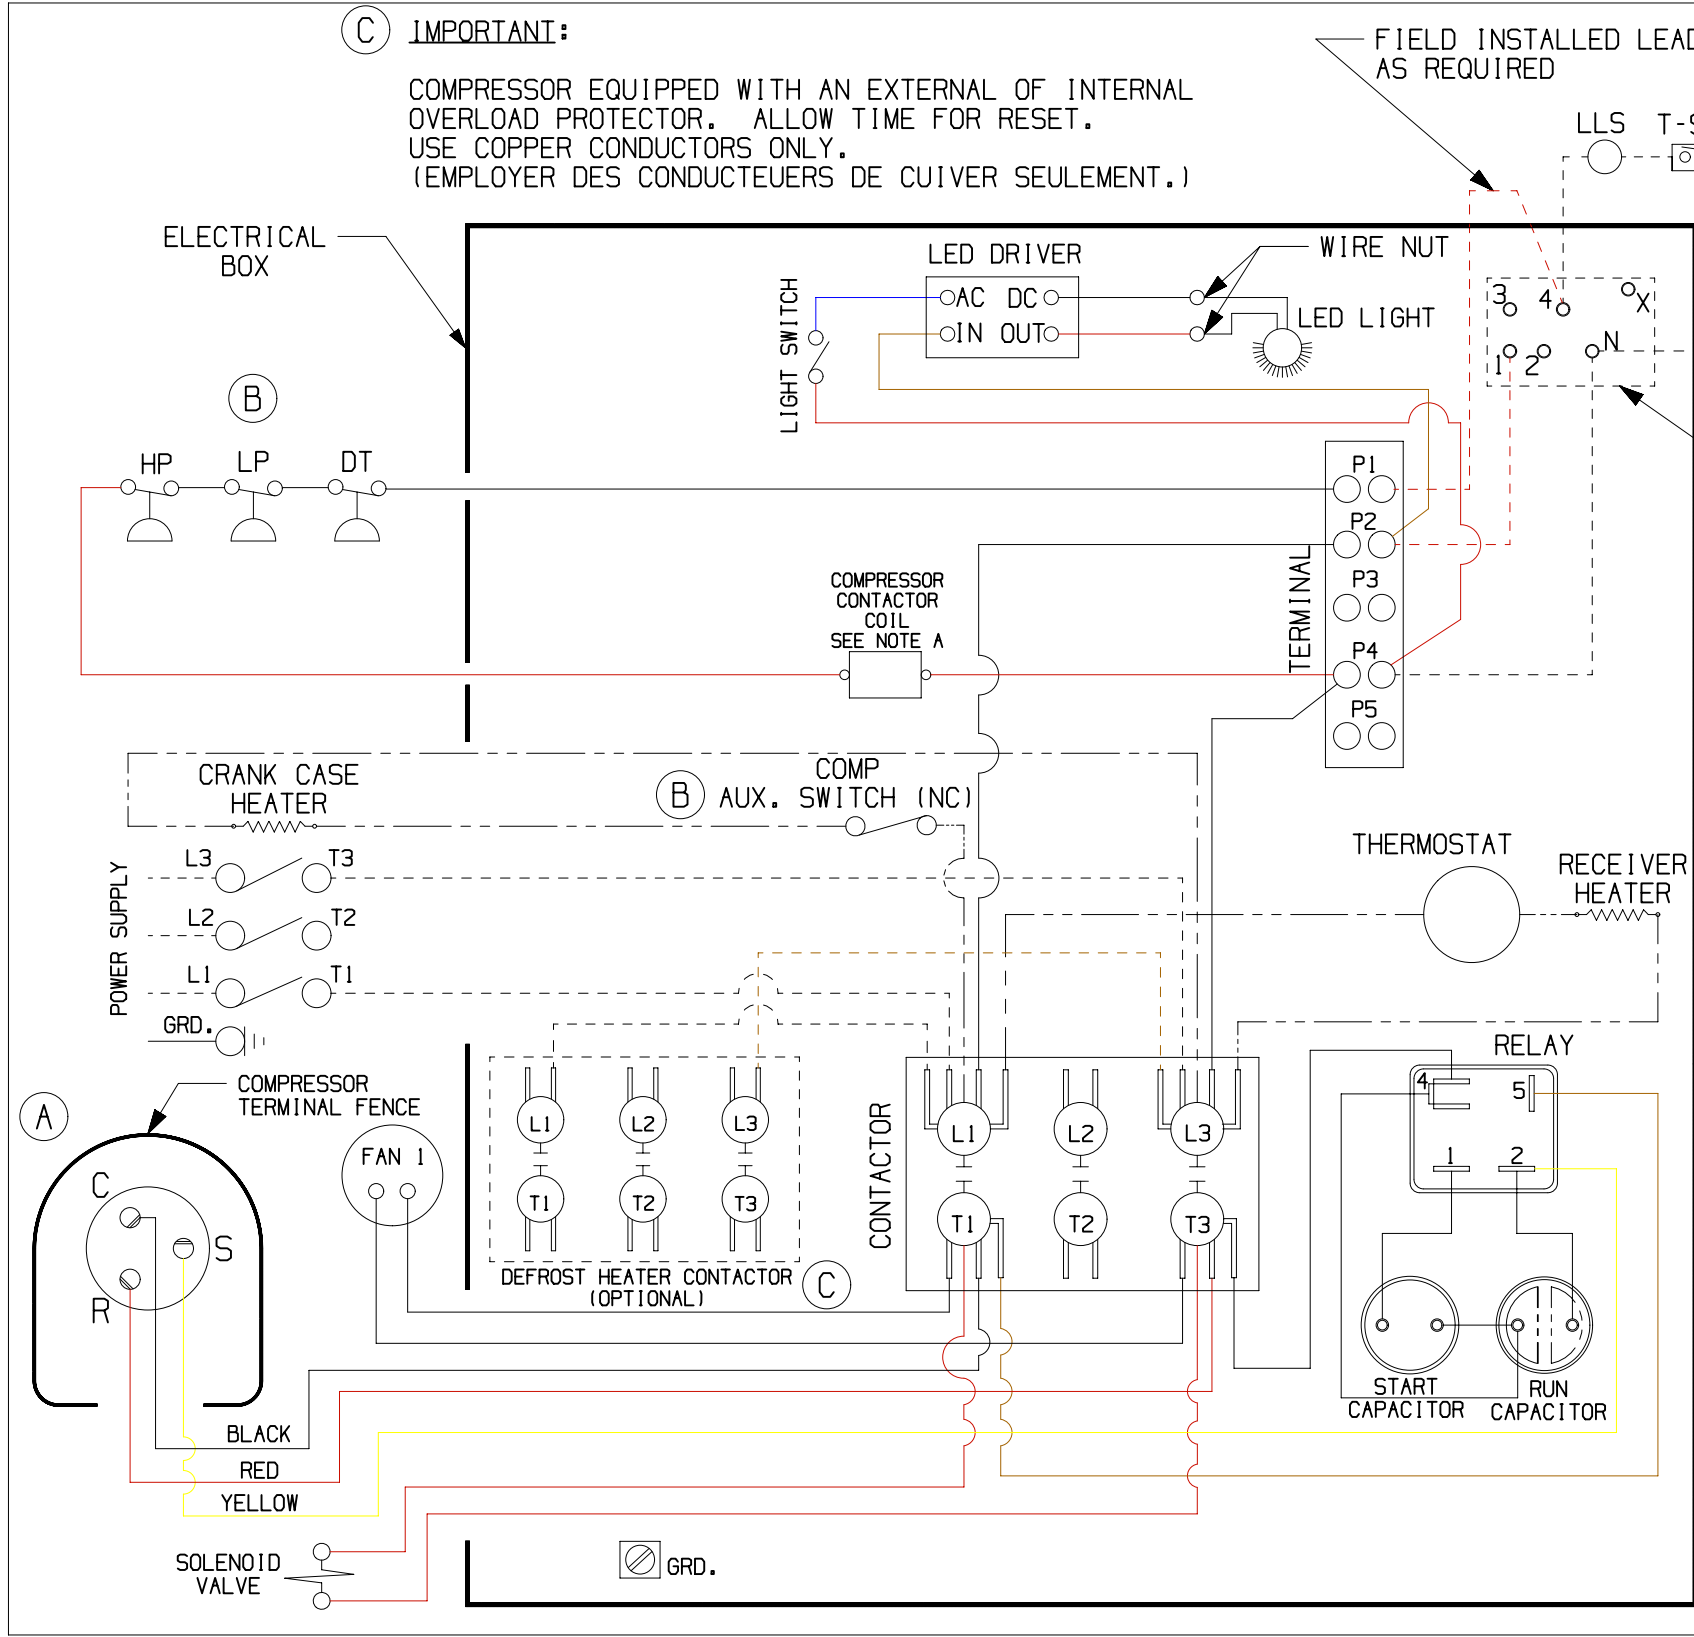


NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COOPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING
3. PLACE JUMPER ACCROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T-STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:

- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED TO 230 V SOURCE IN PANEL AS SHOWN
- B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION
- C. COMPRESSOR EQUIPPED WITH AN INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

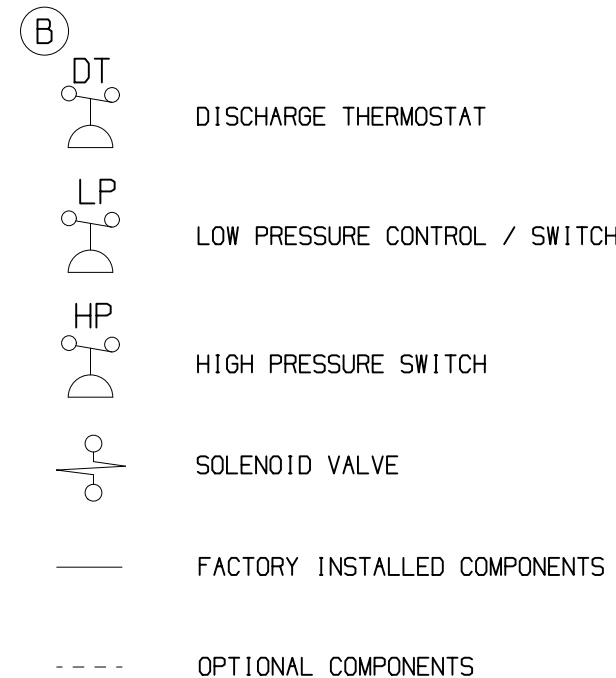


CONDENSING UNIT WIRING

REVISION	C	23JUN21	PART NO.
			91314-IVT

NOTES:

1. REDUCE WHEN PRINTING WITH BORDER LINE OF APPROX. 7.75 x 10.75
2. MATERIAL: Z-ULTIMATE 3000 WHITE.
3. PRINTING TO BE IN COLOR WITH HEAVY ENOUGH PEN WEIGHT AND UL APPROVED INK.
4. MUST COMPLY WITH T.P.Co. GLOBAL SPEC 08.
5. SEE SHEET 2 FOR PRODUCTION PRINTABLE VERSION.

3D,VNX10

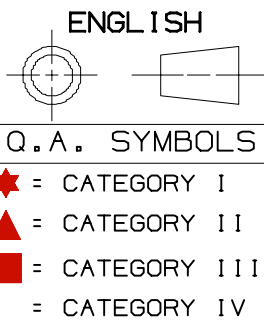

UNIT

WIRING DIAGRAM STICKER

TECUMSEH PRODUCTS CO.
ANN ARBOR, MICHIGAN

MATERIAL

NOTED

DRAWING NO.

91314-IVT

THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY. (TECUMSEH) AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION. IT IS TO BE KEPT IN THE POSSESSION OF THE RECIPIENT ON THE EXPRESS AND EXCLUSIVE CONDITION THAT NEITHER IT NOR THE INFORMATION CONTAINED HEREON OR DISCLOSED THEREIN SHALL BE REPRODUCED, COPIED, REPRODUCED, OR IN ANY MANNER BE LOANED, RENTED, OR OTHERWISE USED WITHOUT THE EXPRESS AND SPECIFIC WRITTEN CONSENT OF TECUMSEH AND THAT SUCH INFORMATION ONLY AS EXPRESSLY AND SPECIFICALLY APPROVED IN WRITING BY TECUMSEH SHALL BE COPIED OR REPRODUCED IN ANY MANNER OR TO ANY EXTENT WITHOUT TECUMSEH'S PRIOR EXPRESS AND SPECIFIC WRITTEN CONSENT AND (IV) SHALL BE RETURNED BY THE RECIPIENT TO TECUMSEH PROMPTLY UPON THE RECIPIENT'S REQUEST.

DIS.CODE
--

NAME

SCALE
1:1 &
NOTED


THIS PRINT SUPERSEDES
ALL PRINTS PRIOR TO

DRAWING NO.

91314-IVT

IMPORTANT:

COMPRESSOR EQUIPPED WITH AN EXTERNAL OF INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.
USE COPPER CONDUCTORS ONLY.
(EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.)

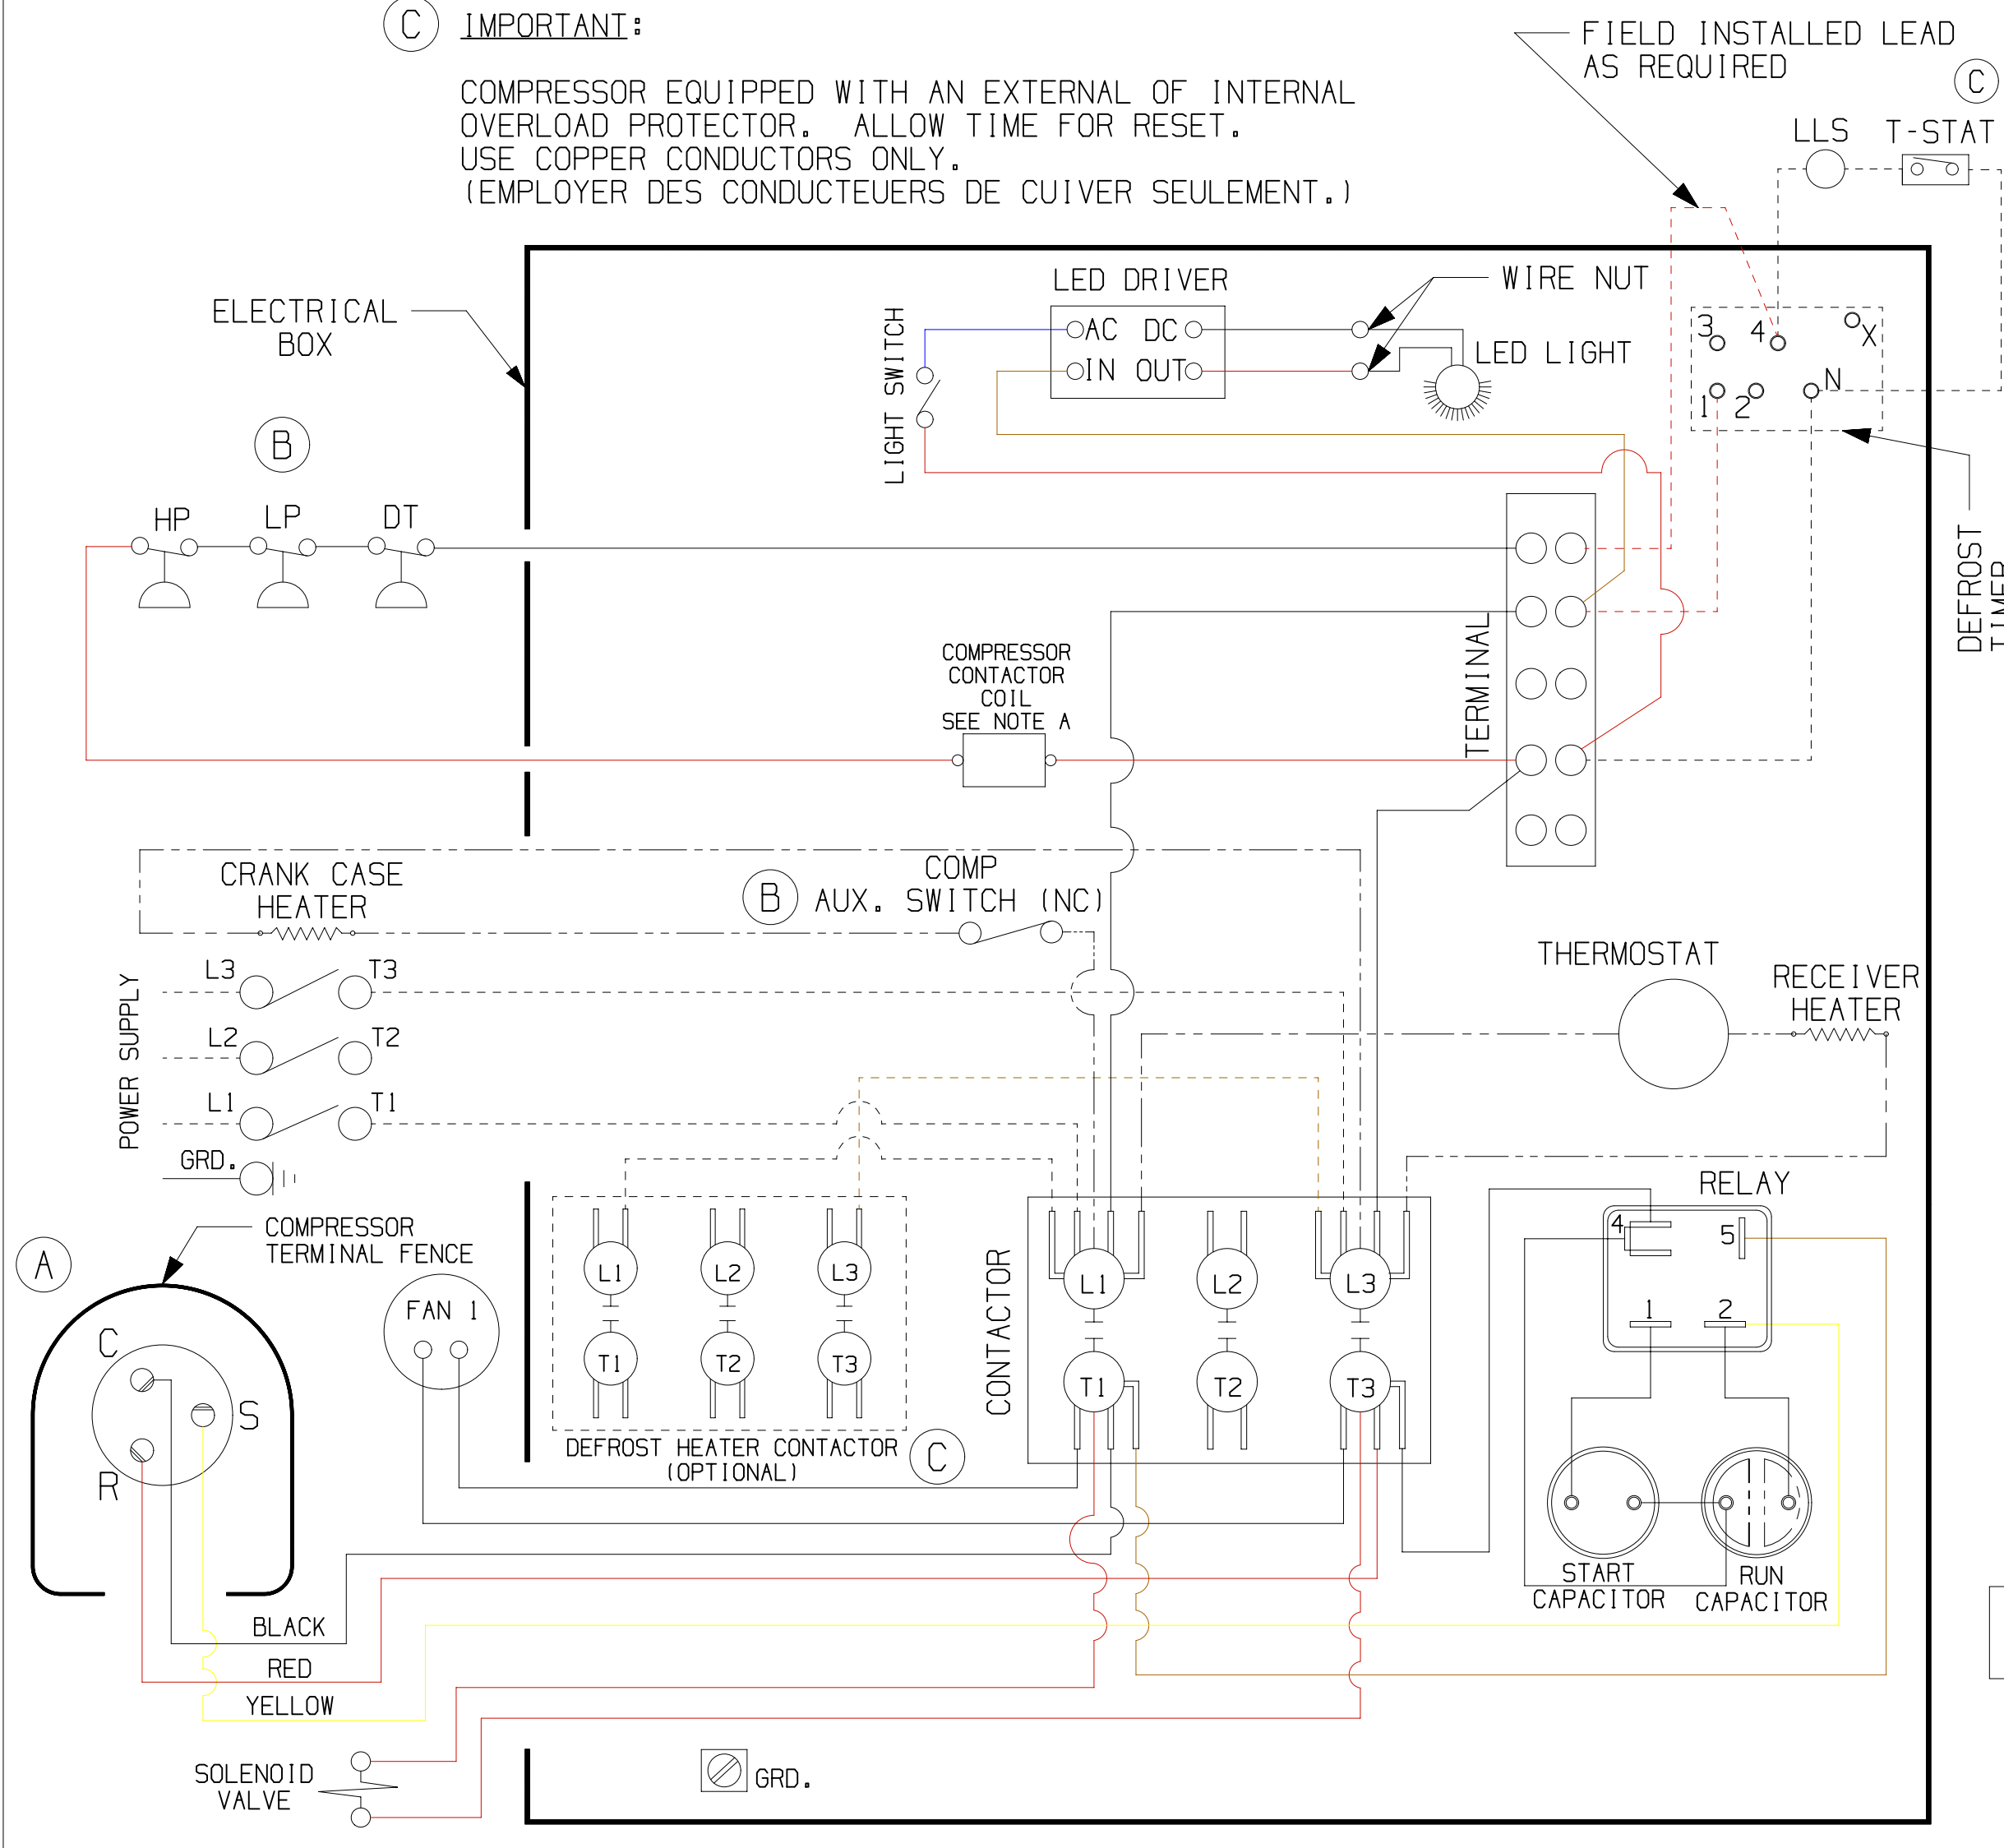

NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COOPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING
3. PLACE JUMPER ACCROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T'STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:

- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED TO 230 V SOURCE IN PANEL AS SHOWN
B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION
C. COMPRESSOR EQUIPPED WITH AN INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

(B)

DT
DISCHARGE THERMOSTAT

LP
LOW PRESSURE CONTROL / SWITCH

HP
HIGH PRESSURE SWITCH

SOLENOID VALVE

FACTORY INSTALLED COMPONENTS

OPTIONAL COMPONENTS

WIRING		PART NO. 91314-IVT
REVISION	23JUN21	