


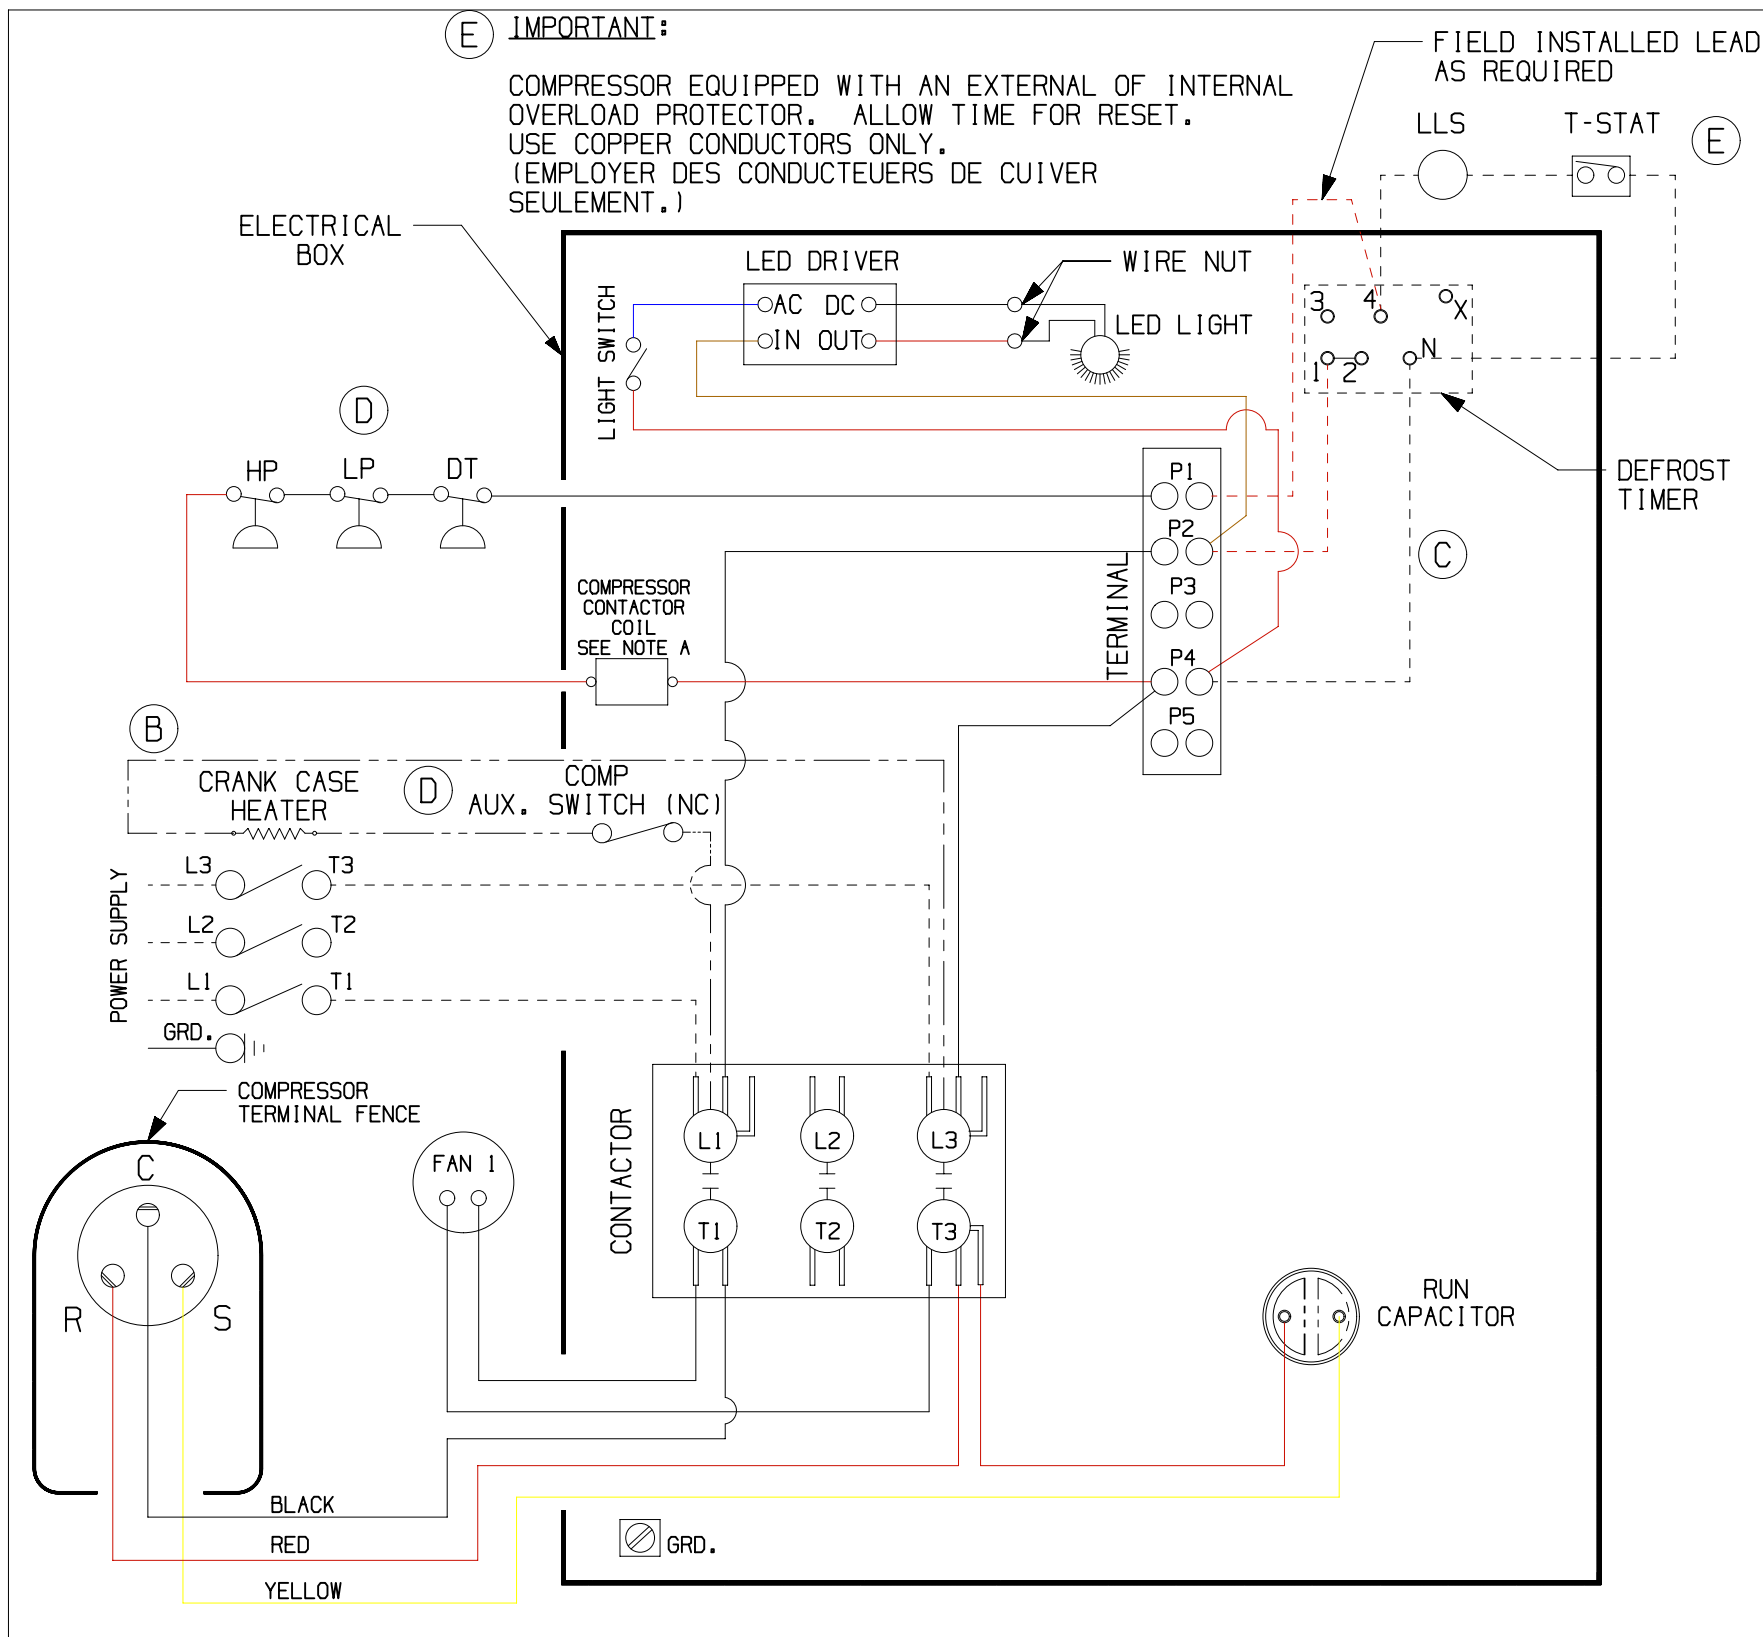


NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COPPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVRE SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING
3. PLACE JUMPER ACROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTA440 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T*STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:

- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED TO 230 V SOURCE IN PANEL AS SHOWN
- B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION
- C. COMPRESSOR EQUIPPED WITH AN INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

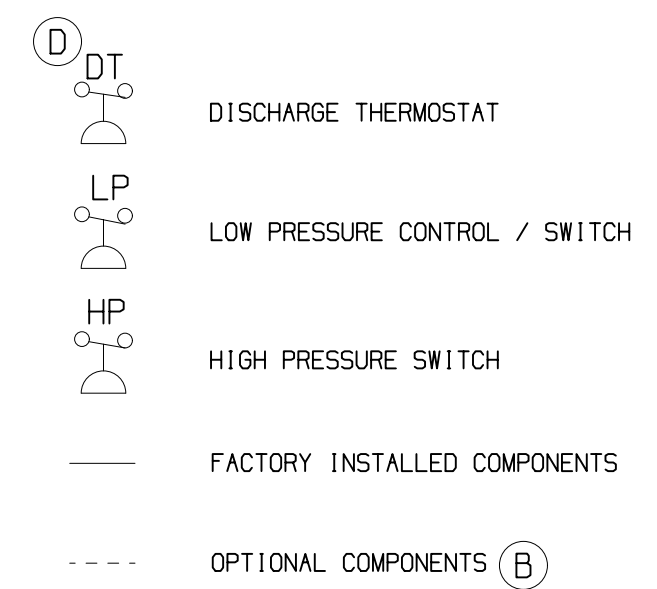

CONDENSING UNIT WIRING


E	16JUN21	PART NO. 91294-1
REVISION		

NOTES :

1. REDUCE WHEN PRINTING WITH BORDER LINE OF APPROX. 7.75×10.75
- (A) 2. MATERIAL: Z-ULTIMATE 3000 WHITE.
- (A) 3. PRINTING TO BE IN COLOR WITH HEAVY ENOUGH PEN WEIGHT AND UL APPROVED INK.
- ▲ 4. MUST COMPLY WITH T.P.Co. GLOBAL SPEC 08.
- (E) 5. SEE SHEET 2 FOR PRODUCTION PRINTABLE VERSION.

3D, VNX10

ENGLISH



Q.A. SYMBOLS


- ★ = CATEGORY I
▲ = CATEGORY II
■ = CATEGORY III
 = CATEGORY IV

UNIT

	E	5D 3D 2B	EC101414 UPDATED WIRING DIAGRAM	TS 16JUN21	
	D	6D 6C 3C	EC95555 UPDATED WIRING DIAGRAM	TS 01MAY20	
	C	4C	EC98259 CHANGED DEFROST TIMER WIRE TO DOTTED LINE	PLN 13MAR19	
	B	2B 6C	EC98290 ADDED OPTIONAL COMPONENT AND CHANGED CCH WIRE TO DASHED LINE	RP 16JAN19	
	A	1A 2B	EC87080 UPDATED NOTE #2, ADDED NOTE #3 & CHANGED FAMILY NAME	RP 17OCT18	
	REL		EC86896	----	
	LT LC		CHANGE	DATE	
THIS DRAWING OR PRINT (I.I.) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY (TECUMSEH) AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION BELONGING TO TECUMSEH. REVISIONS MADE AVAILABLE TO THE RECIPIENT ARE MADE IN ACCORDANCE WITH A SPECIFIC CONDITION THAT NEITHER IT NOR THE INFORMATION CONTAINED THEREON OR DISCLOSED THEREIN SHALL BE DISCLOSED OR MADE AVAILABLE TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF TECUMSEH AND THAT SUCH INFORMATION ONLY AS EXPRESSLY AND SPECIFICALLY APPROVED IN WRITING BY TECUMSEH AND NOT OTHERWISE, (I.I.I.) SHALL BE COPIED OR DUPLICATED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PRIOR EXPRESS AND SPECIFIC RETURNED CONSENT AND (IV) SHALL BE RETAINED BY THE RECIPIENT THEREOF TO REQUEST AT THE LATTER'S REQUEST PROMPTLY AFTER SUCH REQUEST IS MADE.					
		DO NOT SCALE THIS DRAWING ALL FERROUS MATERIALS MUST NOT BE MAGNETIZED AS RECEIVED OR AT COMPRESSOR ASSEMBLY.		DIS.CODE ..	
		NOTED		NAME WIRING DIAGRAM STICKER	
		MATERIAL		SCALE 1:1 & NOTED	
		TECUMSEH PRODUCTS CO. ANN ARBOR, MICHIGAN		THIS PRINT SUPERSEDES ALL PRINTS PRIOR TO	
		DRAWING NO. 91294-1			

(E) IMPORTANT:

COMPRESSOR EQUIPPED WITH AN EXTERNAL OF INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.
USE COPPER CONDUCTORS ONLY.
(EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.)

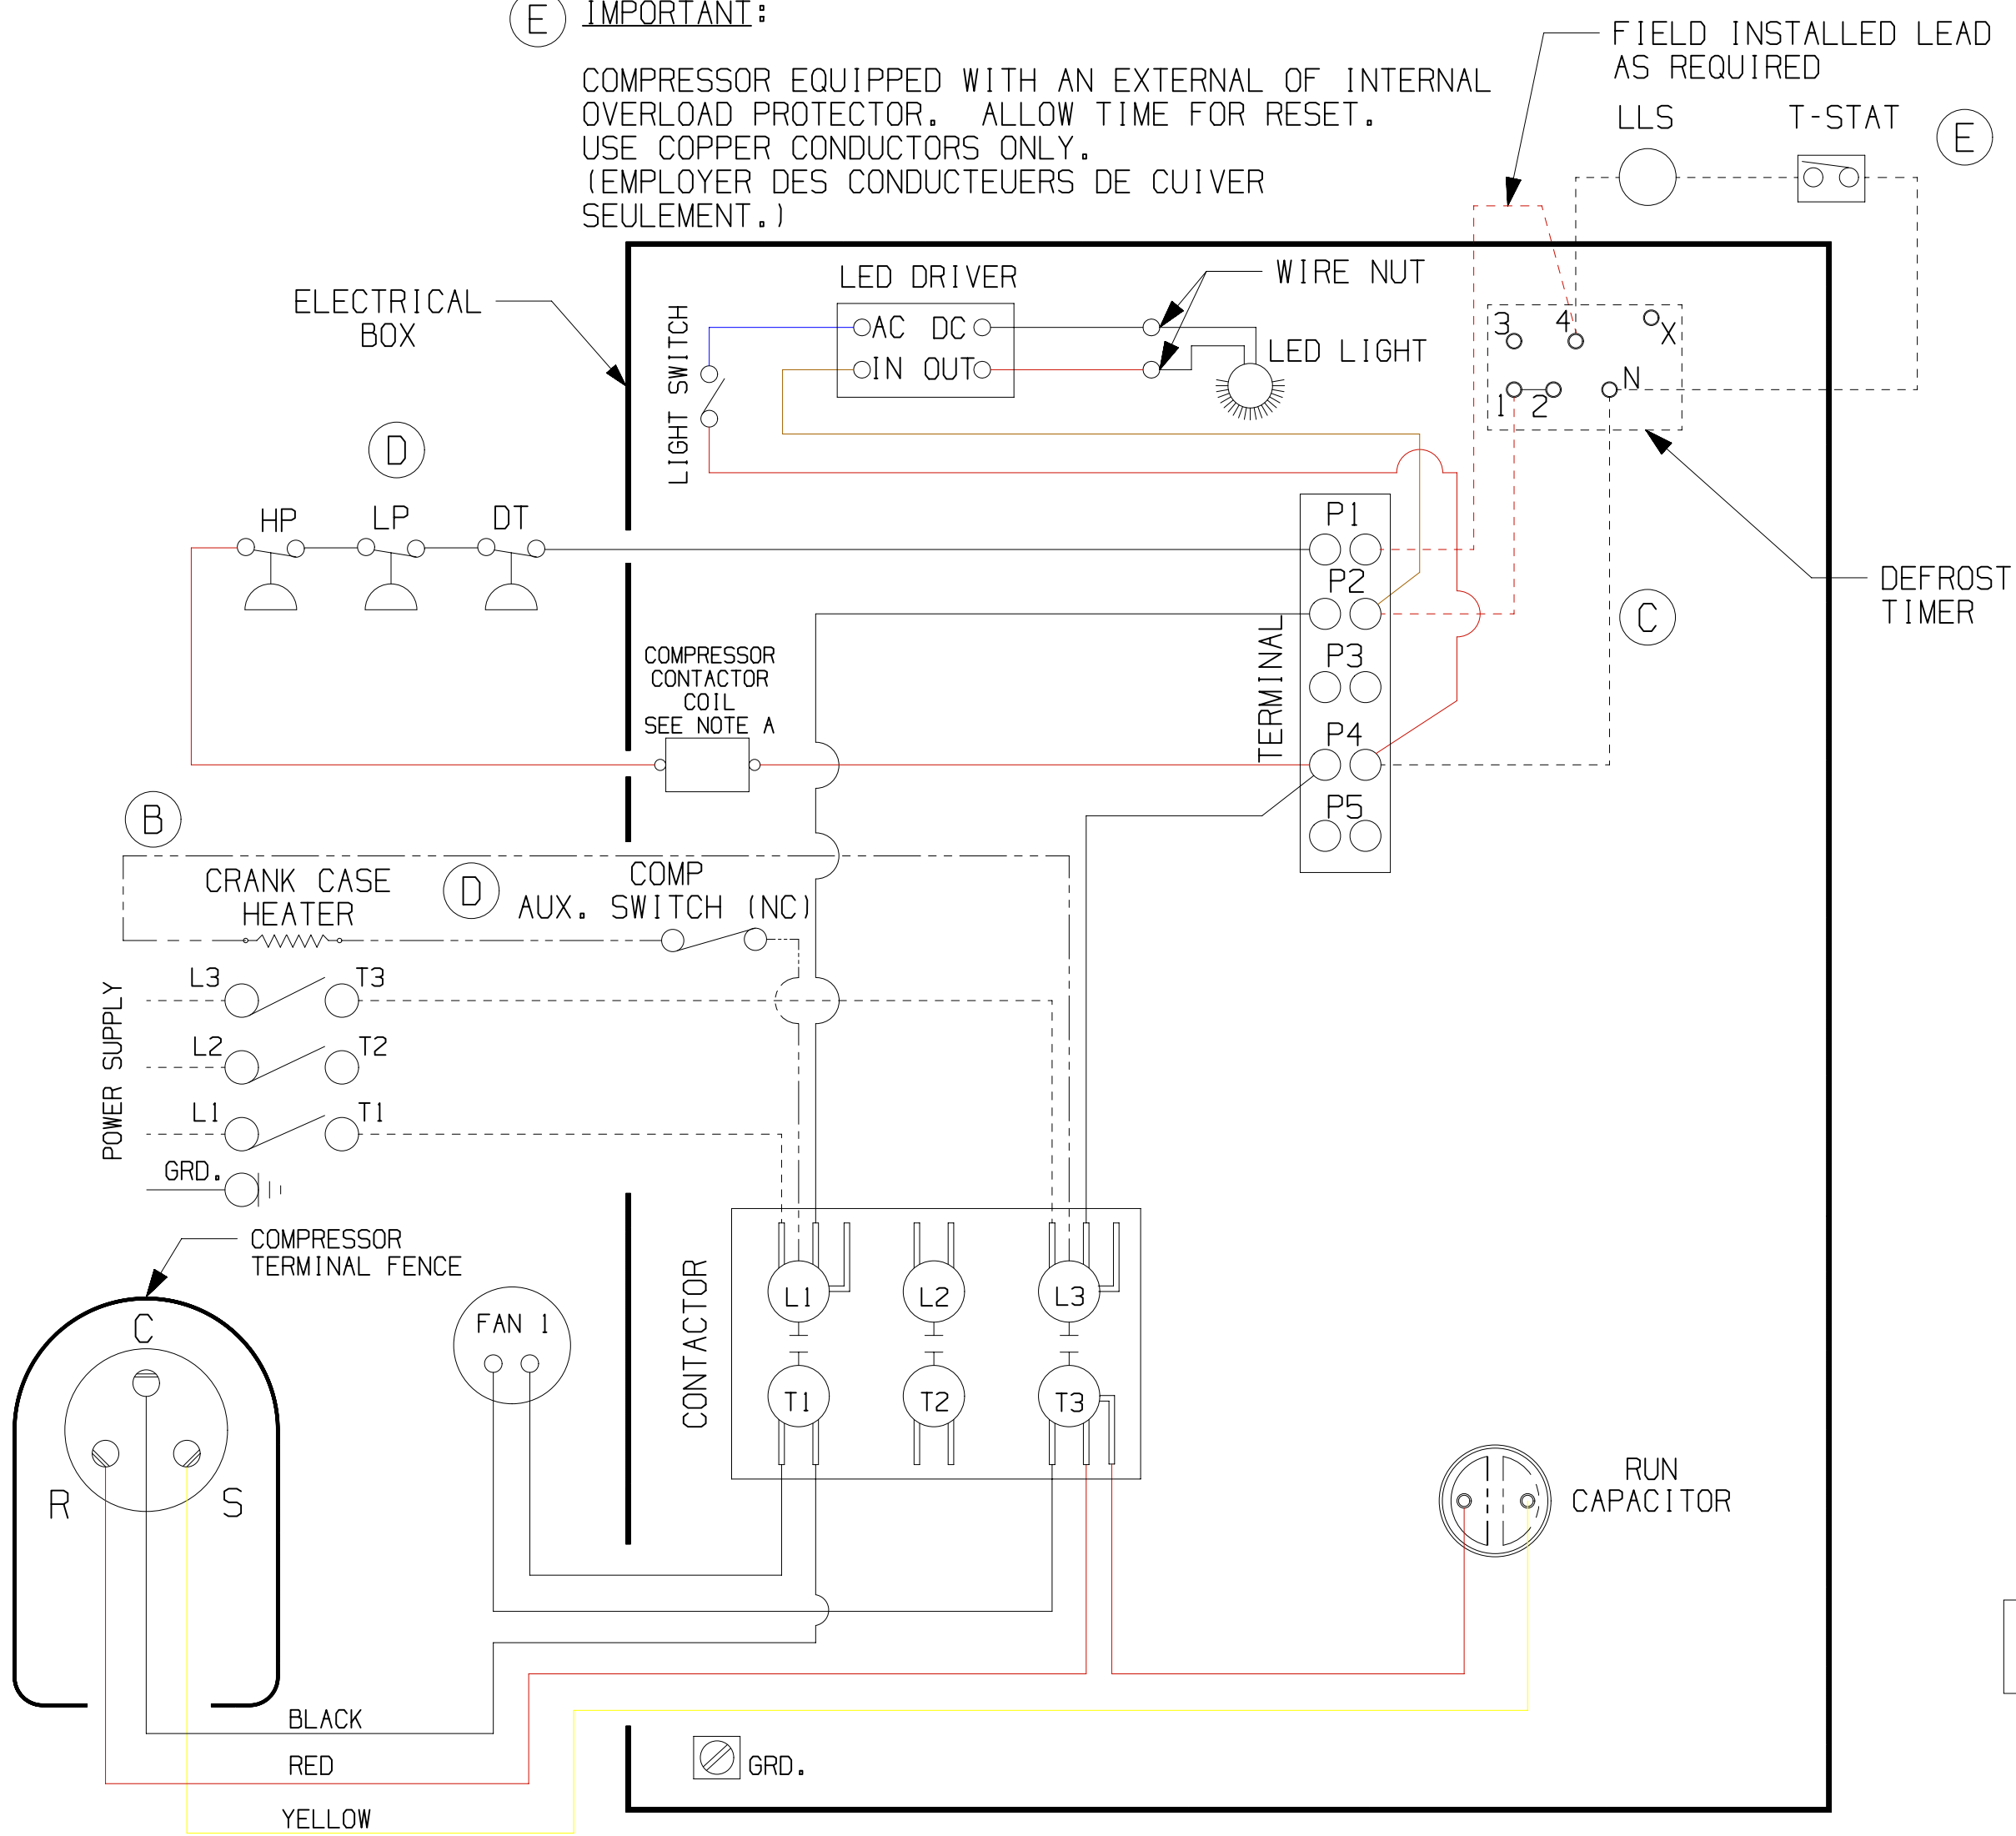


NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COOPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING
3. PLACE JUMPER ACCROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T-STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:

- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED TO 230 V SOURCE IN PANEL AS SHOWN
- B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION
- C. COMPRESSOR EQUIPPED WITH AN INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.

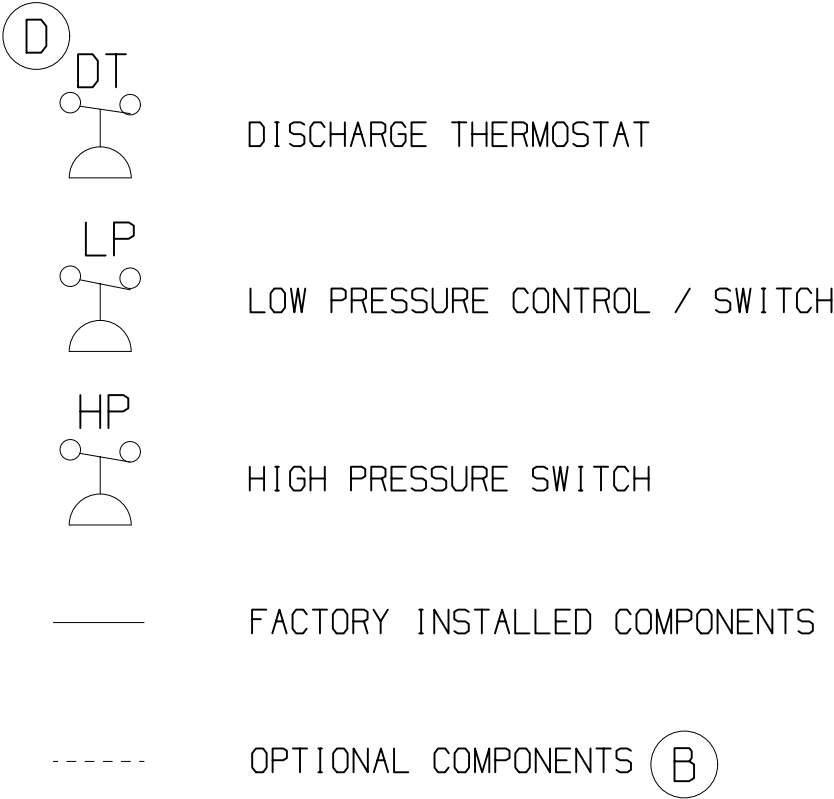

CONDENSING UNIT WIRING



E	16JUN21	PART NO.
REVISION		91294-1