

- ★ = CATEGORY I
- ▲ = CATEGORY II
- = CATEGORY III
- = CATEGORY IV

WIRING DIAGRAM STICKER

TECUMSEH PRODUCTS CO.
ANN ARBOR, MICHIGAN

NOTED

DRAWING NO.
91336

PART NO.
91336

REVISION
C
12JUL23

DIS.CODE

NAME

MATERIAL

SCALE
1:1 &
NOTED

THIS PRINT SUPERSEDES
ALL PRINTS PRIOR TO


NOTES

FIELD WIRING NOTES

1. ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.
2. CONNECT INCOMING POWER LEADS FROM POWER SUPPLY TO L1 AND L3 IN COMPRESSOR CONTACTOR (L1 AND L2 IF TWO POLE CONTACTOR) OR TO L1 AND L3 IN DISCONNECT SWITCH (IF PROVIDED). USE COPPER CONDUCTORS ONLY. (EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.) PROVIDE EQUIPMENT GROUNDING CONDUCTOR. USE 75° C (MIN.) WIRING.
3. PLACE JUMPER ACROSS P1 AND P2 IN TERMINAL BOARD IF NO OTHER CONTROLLING DEVICE IS INSTALLED.
4. DEFROST HEATERS LOADS SHOULD NOT BE HIGHER THEN THE MAXIMUM HEATERS LOAD INDICATED ON THE UNIT LABEL.
5. DEFROST TIMER IS INTERMATIC DTAV40 OR PARAGON 8145-00.
6. IF DEFROST TIMER, LLS & T-STAT ARE LOCATED IN EVAPORATOR, THEN SUPPLY POWER FROM P2 & P4 FROM THE TERMINAL BOARD.

GENERAL NOTES:


- A. CONTACTOR COIL CIRCUIT IS FACTORY CONNECTED IN PANEL AS SHOWN.
- B. WITH ANY T.P.Co. APPROVED START RELAY USED, CONNECT LEADS TO SAME NUMBERED TERMINALS REGARDLESS OF LOCATION.
- C. COMPRESSOR EQUIPPED WITH AN EXTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.



- DT DISCHARGE THERMOSTAT
- LP LOW PRESSURE CONTROL / SWITCH
- HP HIGH PRESSURE SWITCH
- FACTORY INSTALLED COMPONENTS
- - - OPTIONAL COMPONENTS

CONDENSING UNIT WIRING

IMPORTANT:
COMPRESSOR EQUIPPED WITH AN EXTERNAL OF INTERNAL OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.
USE COPPER CONDUCTORS ONLY.
(EMPLOYER DES CONDUCTEURS DE CUIVER SEULEMENT.)

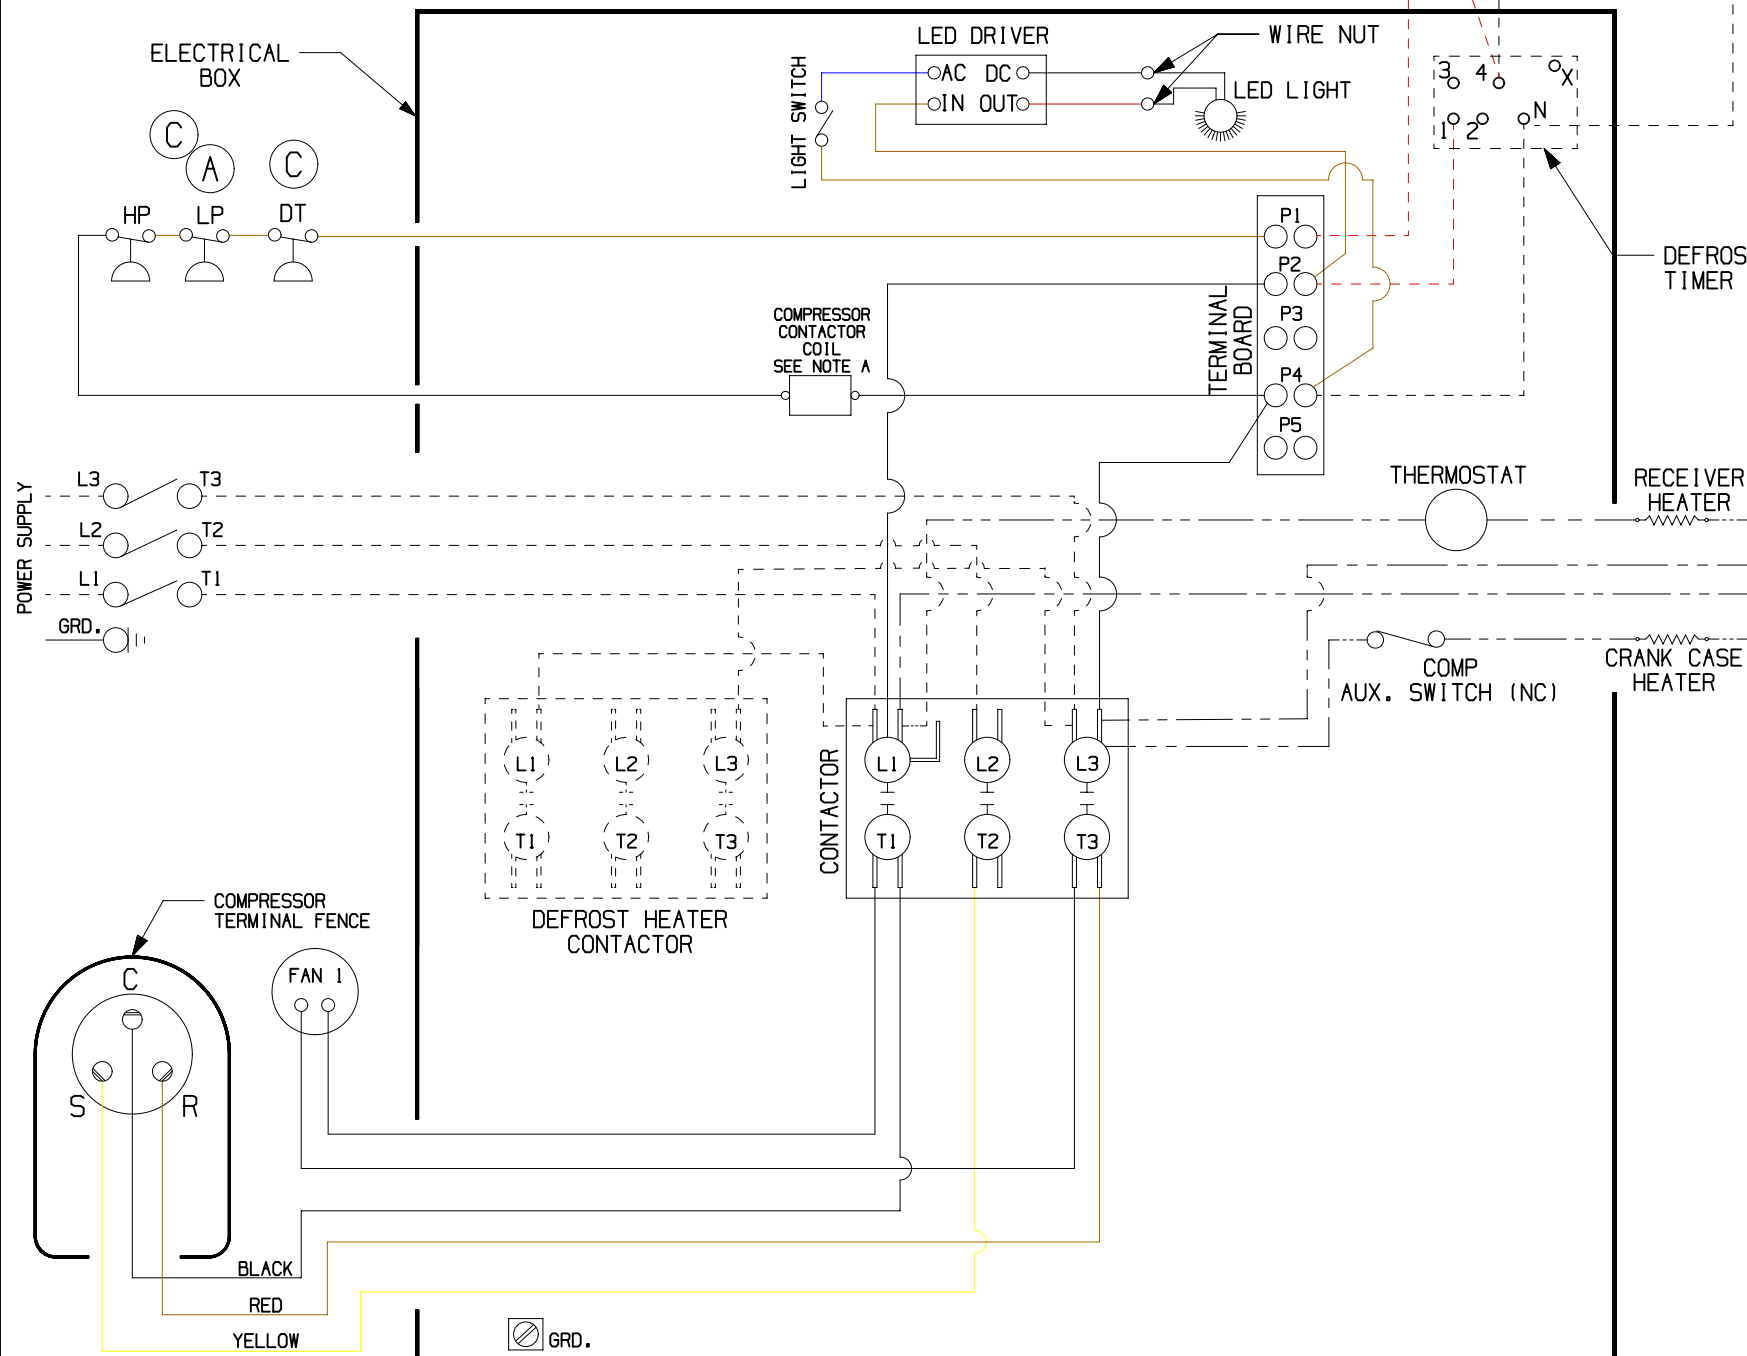


NOTES:

1. REDUCE WHEN PRINTING WITH BORDER LINE OF APPROX. 7.75 x 10.75
2. MATERIAL: Z-ULTIMATE 3000 WHITE.
3. PRINTING TO BE IN COLOR WITH HEAVY ENOUGH PEN WEIGHT AND UL APPROVED INK.
4. MUST COMPLY WITH T.P.Co. GLOBAL SPEC 08.
5. THIS IS CREATED USING 91321.
6. SEE SHEET 2 FOR PRODUCTION PRINTABLE VERSION.

LT	LC	CHANGE	DATE	THIS DRAWING OR PRINT (1) IS THE PROPERTY OF TECUMSEH PRODUCTS COMPANY (TECUMSEH) AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION. ANY REPRODUCTION OR USE OF THIS DRAWING OR PRINT WITHOUT THE WRITTEN CONSENT OF TECUMSEH IS PROHIBITED. ANY REPRODUCTION OR USE OF THIS DRAWING OR PRINT WITHOUT THE WRITTEN CONSENT OF TECUMSEH SHALL BE AT THE RECIPIENT'S RISK AND WITHOUT LIABILITY TO TECUMSEH. ANY REPRODUCTION OR USE OF THIS DRAWING OR PRINT WITHOUT THE WRITTEN CONSENT OF TECUMSEH SHALL BE AT THE RECIPIENT'S RISK AND WITHOUT LIABILITY TO TECUMSEH.
C	5D	EC109884 UPDATED WIRING DIAGRAM	SIMRAN 12JUL23	
B	3D 5D 6A	EC101564 UPDATED WIRING DIAGRAM AND NOTES	TS 25JUN21	
A	5D	EC95641 REVISED WIRING DIAGRAM	TS 15APR20	
REL		EC95273	----	

COMPRESSOR EQUIPPED WITH AN EXTERNAL OR INTERNAL
OVERLOAD PROTECTOR. ALLOW TIME FOR RESET.
USE COPPER CONDUCTORS ONLY.
(EMPLOYER DES CONDUCTEURS DE CUIVRE SEULEMENT.)

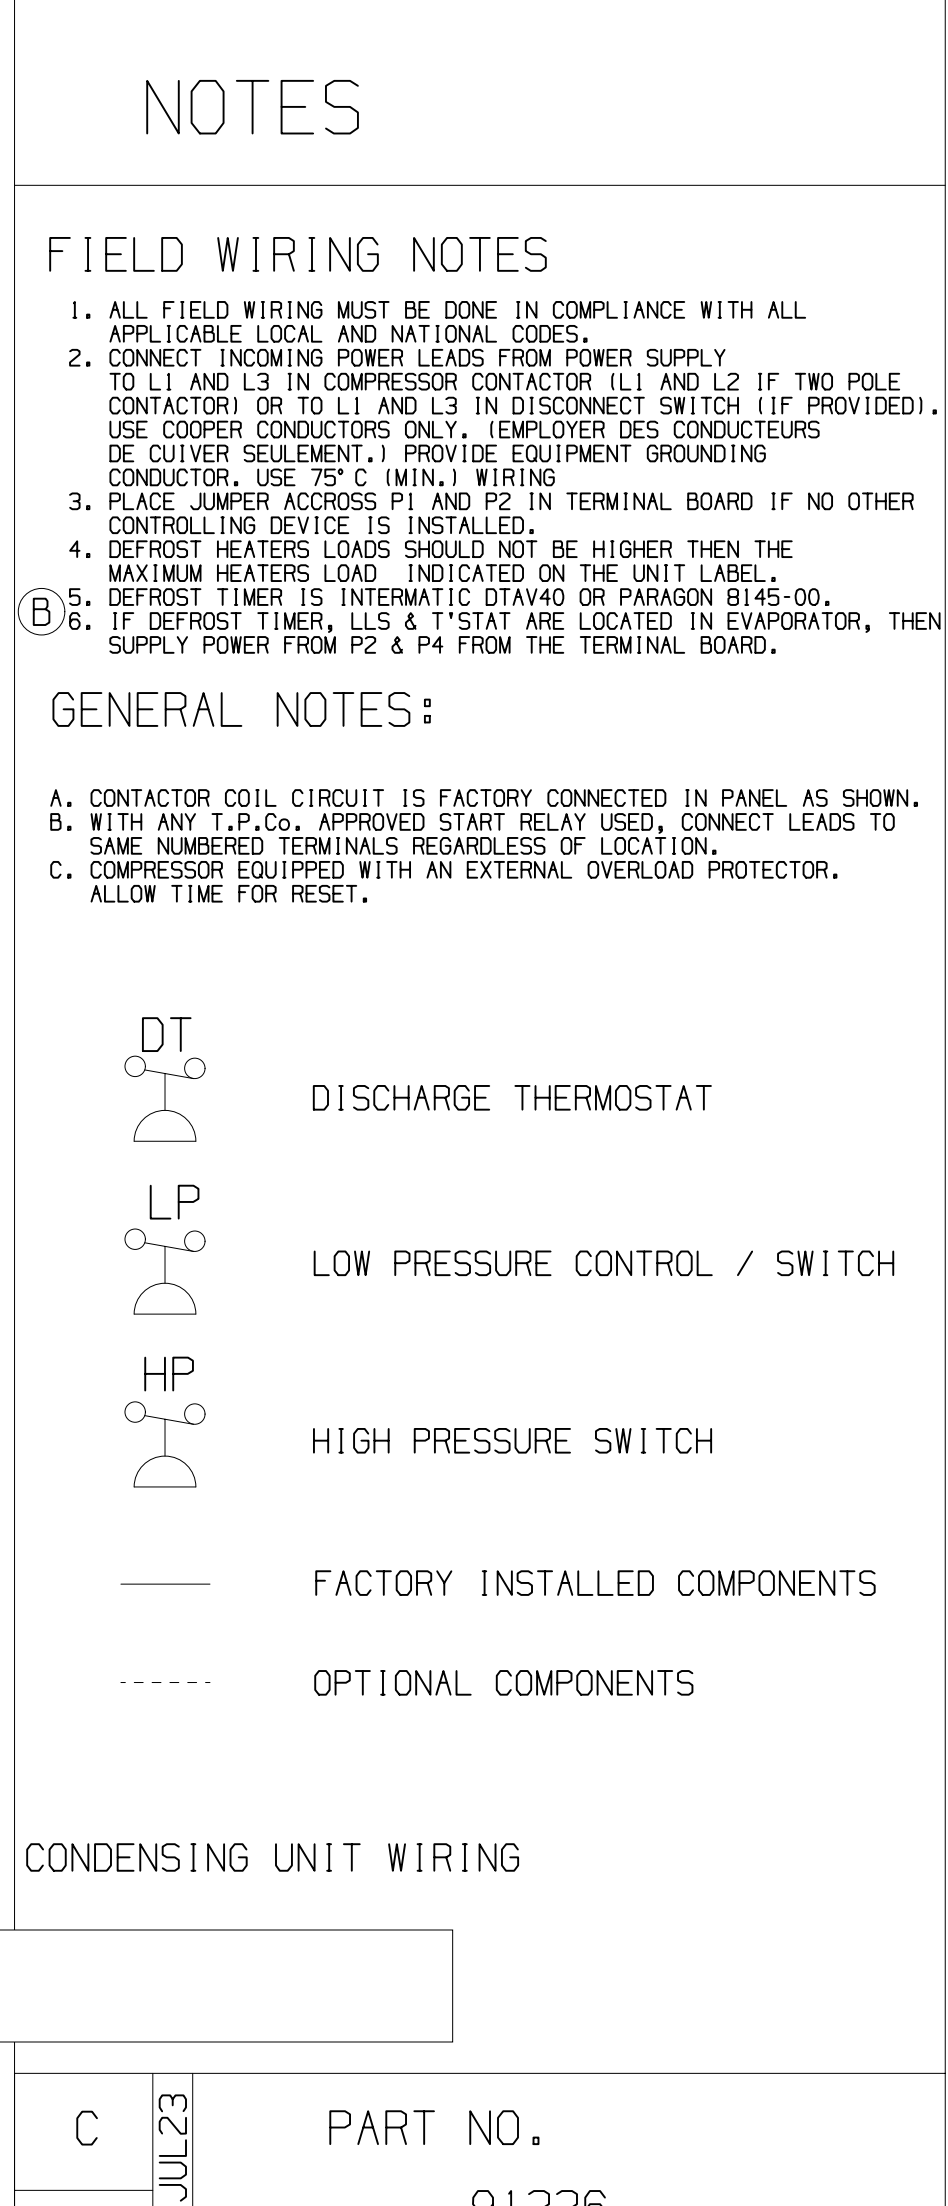

CONDENSING UNIT WIRING

C
REVISION

12JUL23	
---------	--

PART NO.
91336